



Certificate of Conformity - Particle Size Distribution 2025


Site:	Sheehan Soil Washing Plant
Material Type:	Clay, Cohesive fill material
Certificates of analysis included:	25-001473, 25-029180-1, 25-039585-1, 25-062490-5 & 25-066709

Date:	Feb-26
Version:	1

Particle Size (mm)	Average % Passing	Specification for highway works CC 601, Class 2A/2B	Pass/ Fail
500	100		
300	100		
150	100		
125	100	100 -100	PASS
63	100		
50	100		
37.5	100		
28	100		
14	100		
10	100		
6.3	100		
5	100		
3.35	99		
2	99	80 - 100	PASS
1.18	99		
0.6	98		
0.425	98		
0.3	97		
0.212	96.0		
0.15	95.0		
0.063	93.0	15 - 100	PASS
0.002	67.0		

Non Engineering Description
Brown slightly sandy silty CLAY.

Notes
The yearly average, indicates grading complies with CC 601 Specifications for a 2A/2B material

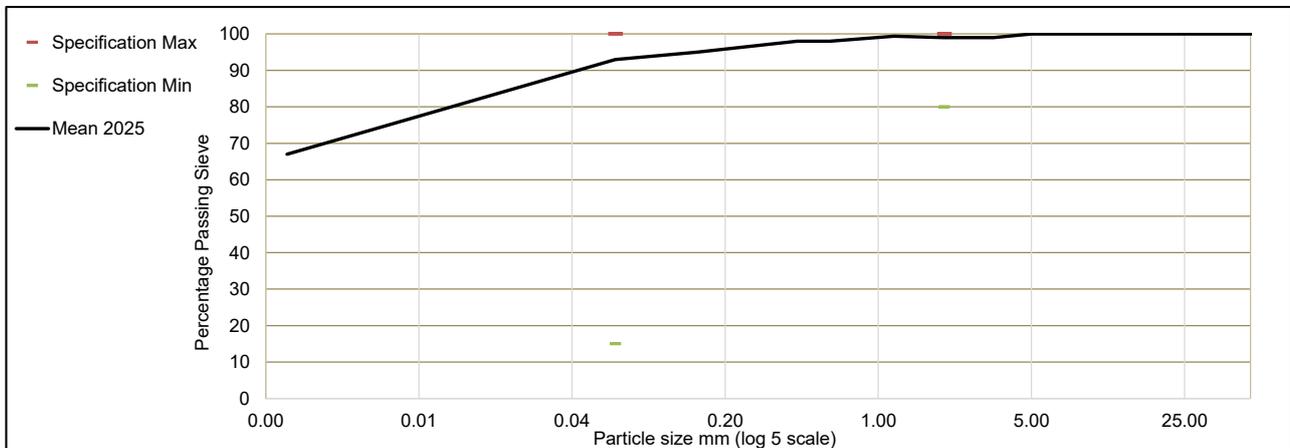

1. This is a certificate of conformity sheet for 2025.
 2. The certificate uses the average of the data collected in 2025 from accredited geotechnical laboratory I2 Analytical Ltd.