



Certificate of Conformity - Particle Size Distribution 2025

Site:	Sheehan Soil Washing Plant
Material Type:	40/ 75 mm Washed Stone
Certificates of analysis included:	25-015238, 25-029180-1, 25-051091-1 & 25-066709


Date:	Feb-26
Version:	1

Particle Size (mm)	Average % Passing	Specification for highway works CC 601, Class 6A	Pass/Fail
500	100	100 - 100	PASS
300	100		
125	100		
80	90		
63	38		
40.0	3		
31.5	2		
20	2		
16	2		
14	2		
10	2	0 -100	PASS
6.3	2	0 - 85	PASS
4	2		
2.80	2		
2.0	2		
1	2		
0.5	2	0 - 45	PASS
0.3	1		
0.13	1		
0.063	1.08	0 - 5	PASS

Non Engineering Description
Multicolour GRAVEL and COBBLES with asphalt.

Notes
The yearly average, indicates grading complies with CC 601 Earthwork Specifications for 6A material

Yearly Average - Constituents	
% Class 'X' material	0.00%
Compliant with CC 601 specification	

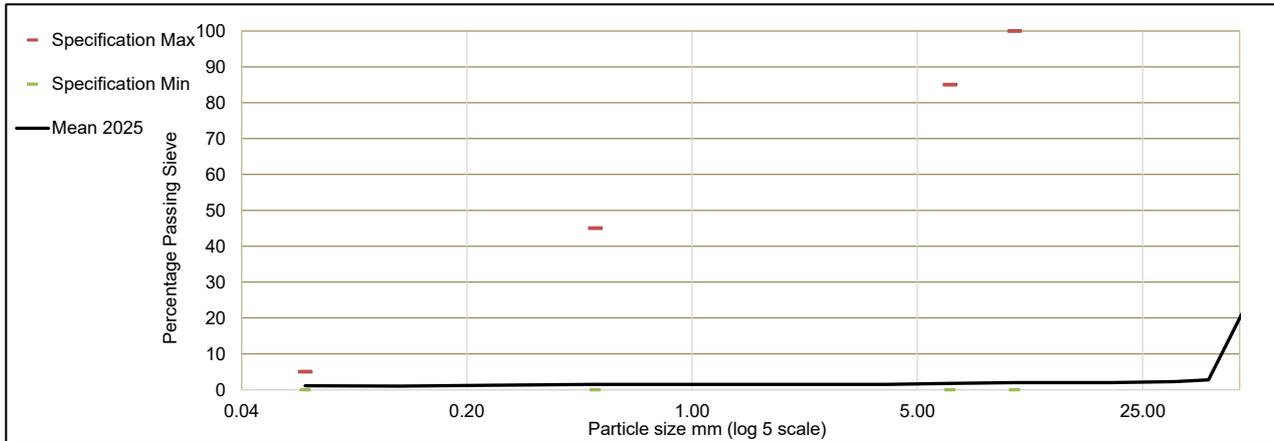

1. This is a certificate of conformity sheet for 2025.
 2. The certificate uses the average of the data collected in 2025 from accredited geotechnical laboratory i2 Analytical Ltd.