



## Certificate of Conformity - Particle Size Distribution 2025

Site:	Sheehan Soil Washing Plant
Material Type:	4/10 mm Washed Stone
Certificates of analysis included:	25-015238-1, 25-029180-1, 25-039585, 25-062490-5 & 25-066709


Date:	Feb-26
Version:	1

Particle Size (mm)	Average % Passing	Specification for highway works CC 601, Class 1B	Pass/Fail
500	100		
300	100		
125	100	100 -100	PASS
80	100		
63	100		
40	100		
31.5	100		
20	100		
16	100		
14	100		
10	67		
8	41		
6.3	19		
4	3		
2.8	1		
2	1		
1	1		
0.5	1		
0.25	1		
0.125	1		
0.063	0.5	0 - 15	PASS

Non Engineering Description
Multicolour GRAVEL with asphalt.

Notes
The yearly average, indicates grading complies with CC 601 earthwork specification for a 1B material.

Yearly Average - Constituents	
% Class 'X' material	0.08%
Compliant with CC 601 specification	

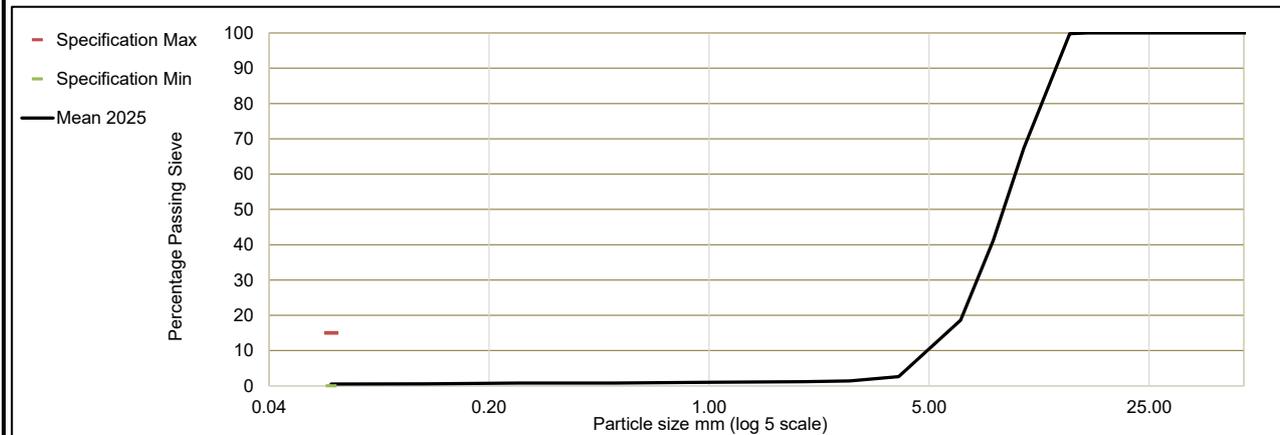

1. This is a certificate of conformity sheet for 2025.  
 2. The certificate uses the average of the data collected in 2025 from accredited geotechnical laboratory i2 Analytical Ltd.